





# INSTALLATION INSTRUCTIONS

## APB1000A EMERGENCY ACCESS PANEL

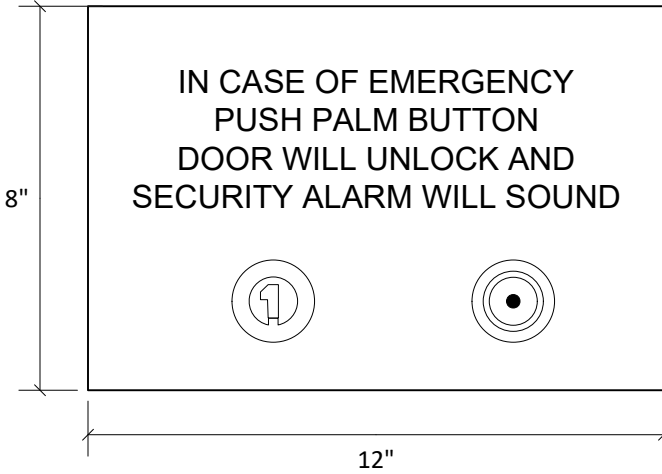

SOME INSTALLATIONS REQUIRE THAT THE WIRING BE ENCLOSED WITHIN A CONDUIT. A 4 GANG ELECTRICAL DEEP BOX MAY BE USED TO ENCLOSE THE SWITCHES

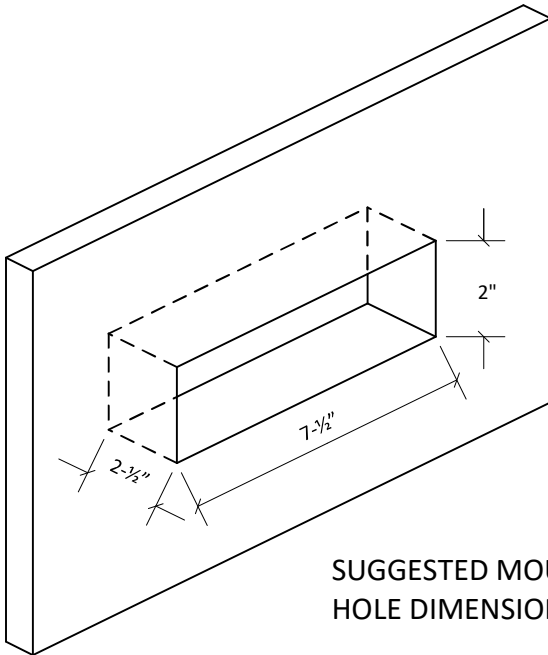



### TYPICAL WIRING

